



7.1.6


## Quality Audits :- Geotagged Photographs




# ANNEXURE- IV

# PHOTOGRAPHS

  
H.P. SINGH  
EXECUTIVE ENGINEER  
PUNJAB TECHNICAL UNIVERSITY  
JALANDHAR 

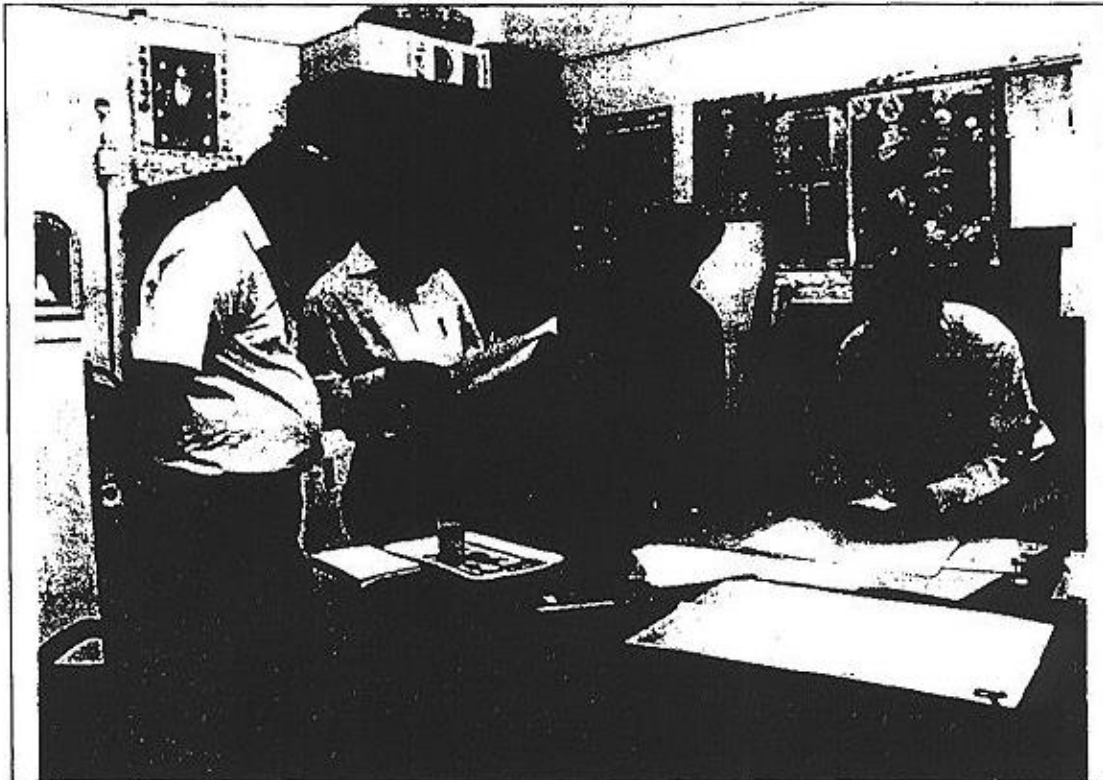


Detailed discussions with PTU Officers before Detailed Energy Audit

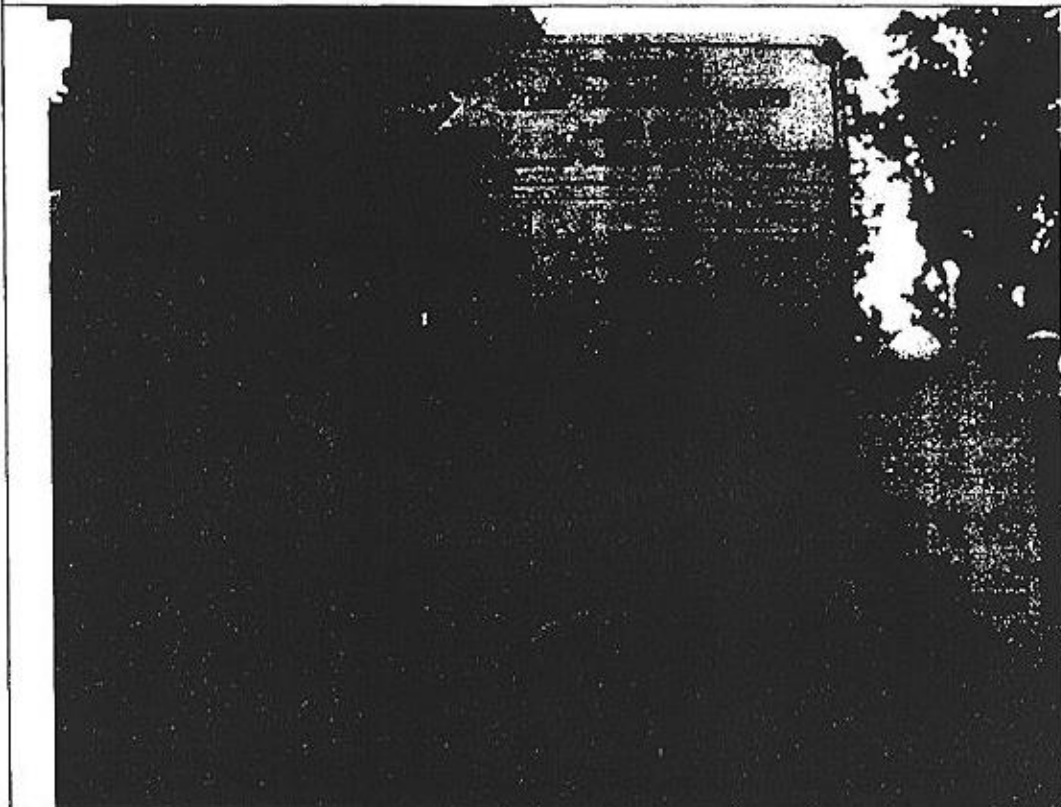


Rated Data of 1000 kVA transformer

*H.P. SINGH*  
H.P. SINGH  
EXECUTIVE ENGINEER  
PUNJAB TECHNICAL UNIVERSITY  
JALANDHAR

*hail*

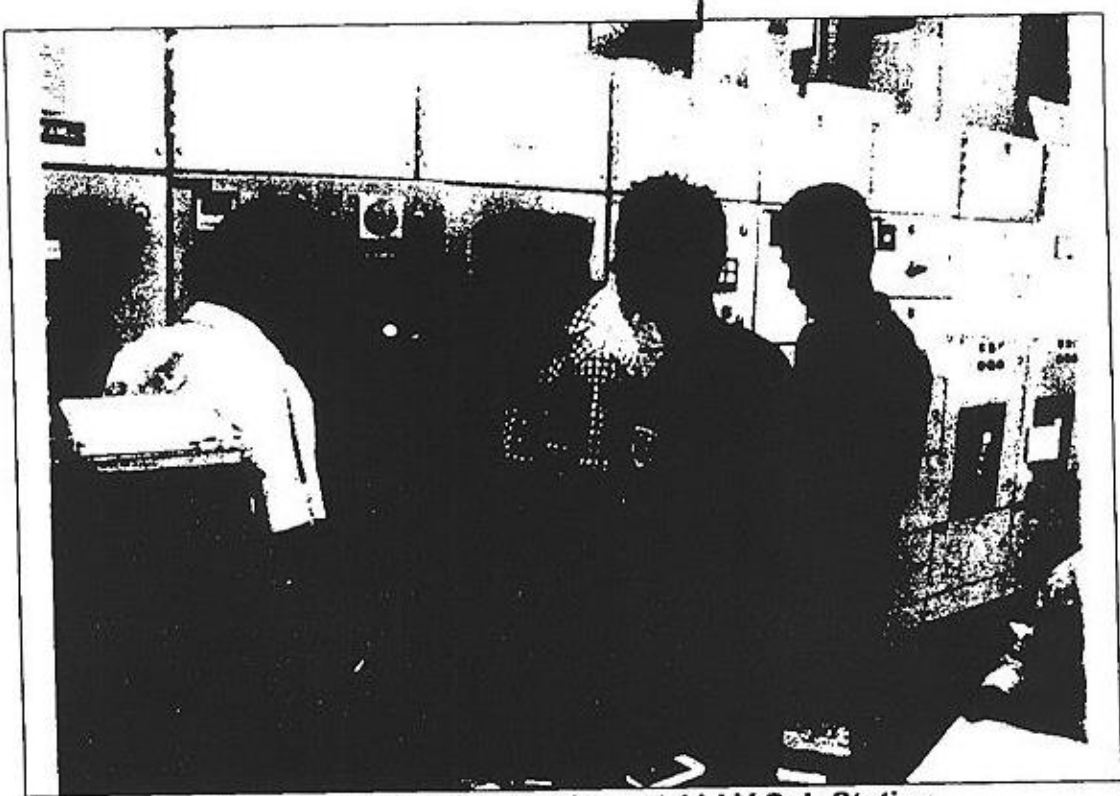


Measurement of Energy Data at 11 kV Sub Station

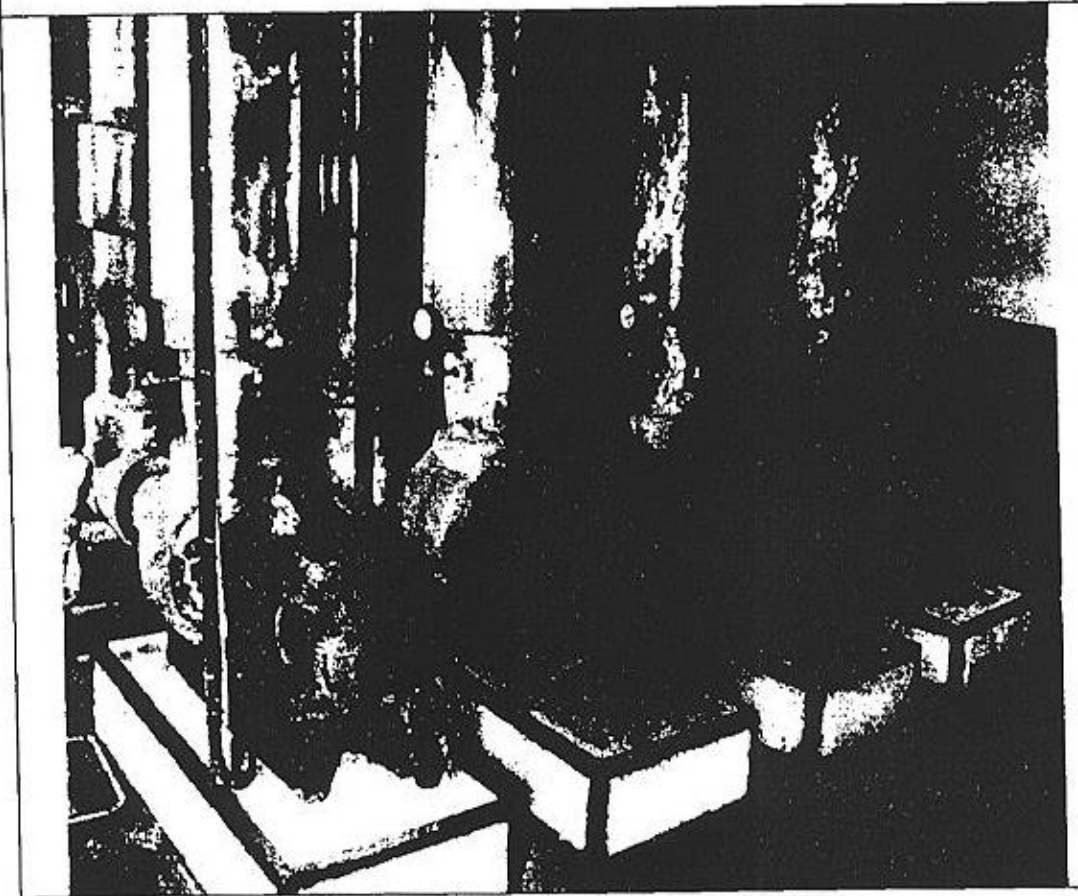

View of Primary Chilled Water Pumps

H.P. SINGH  
EXECUTIVE ENGINEER  
PUNJAB STATE ELECTRICITY BOARD  
JALANDHAR


*Handwritten signature*

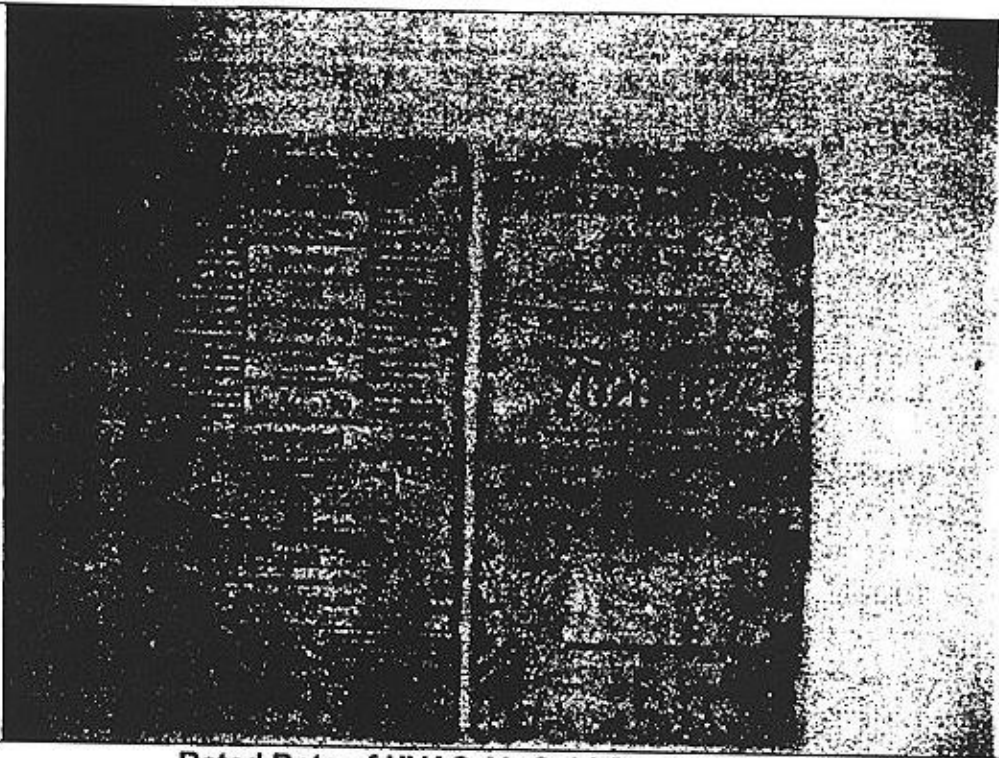

**Rated Data of HVAC Air Cold Screw Chillers**




**View of Detailed Energy Audit of HVAC Plant**

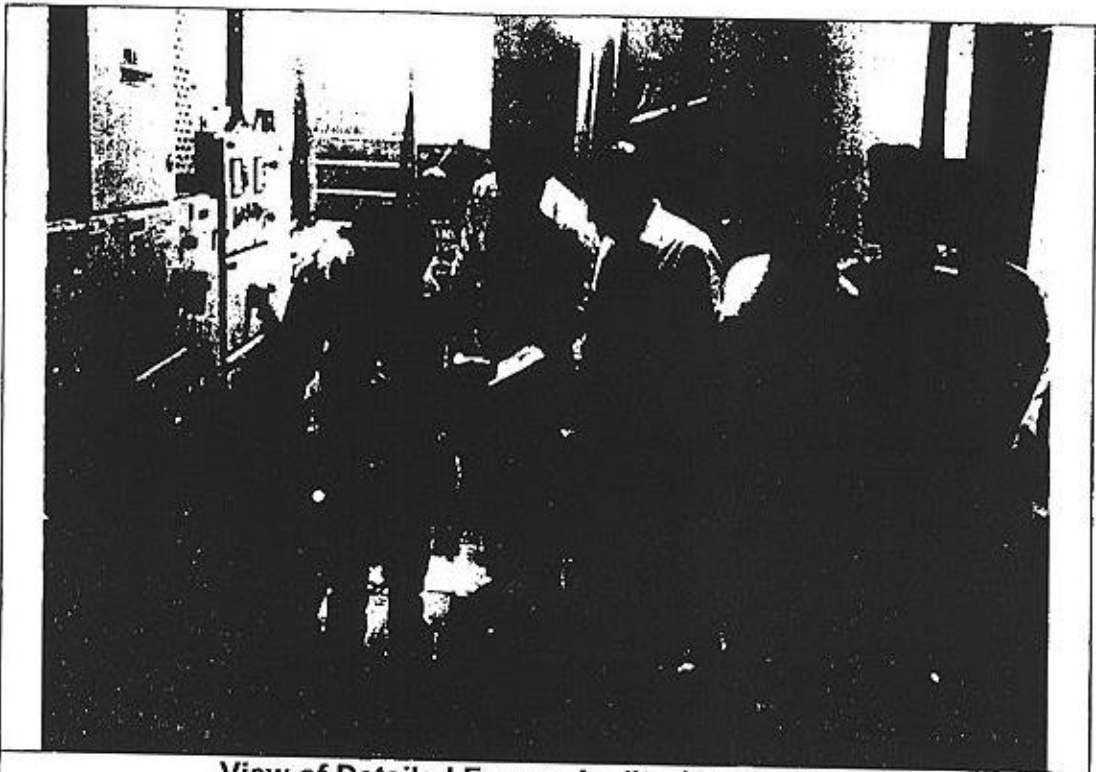

View of Detailed Energy Audit of HVAC Plant




View of Detailed Energy Audit of AHUs

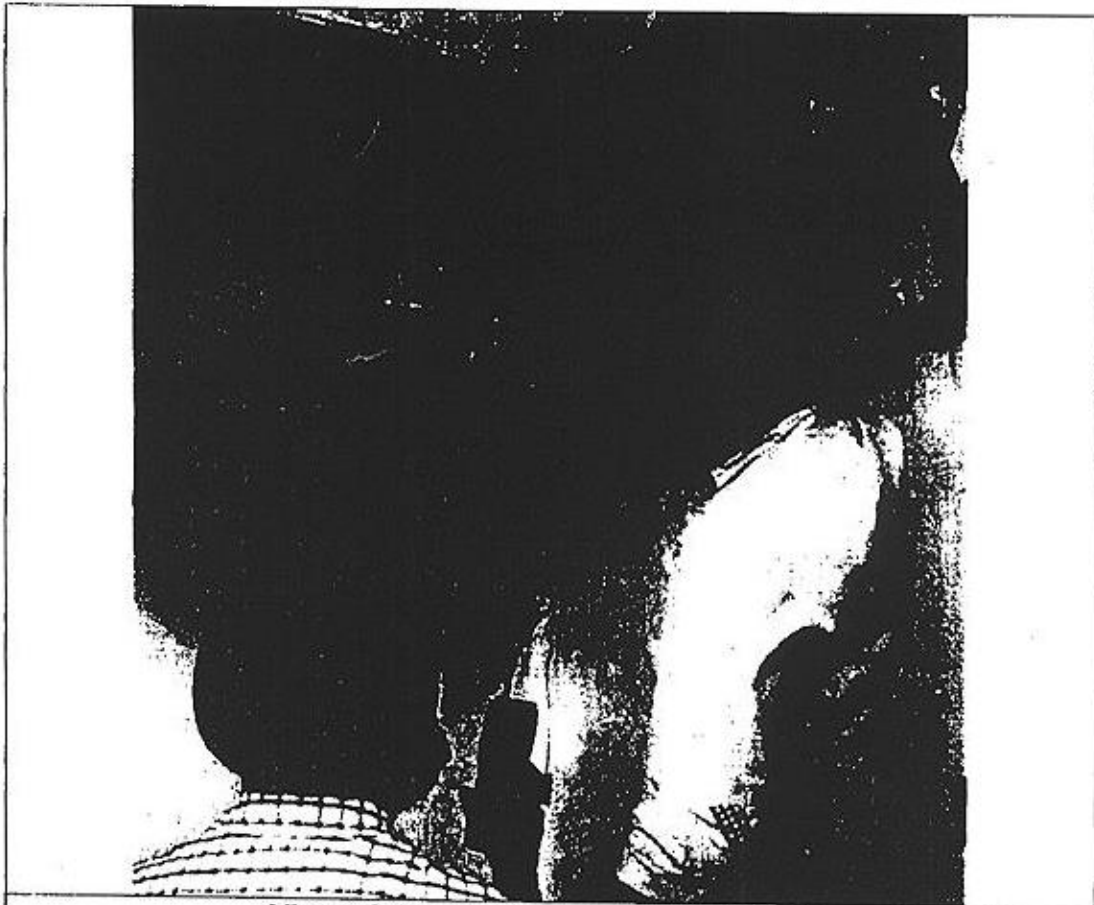


View of Detailed Energy Audit of AHUs




View of Detailed Energy Audit of Submersible Pump

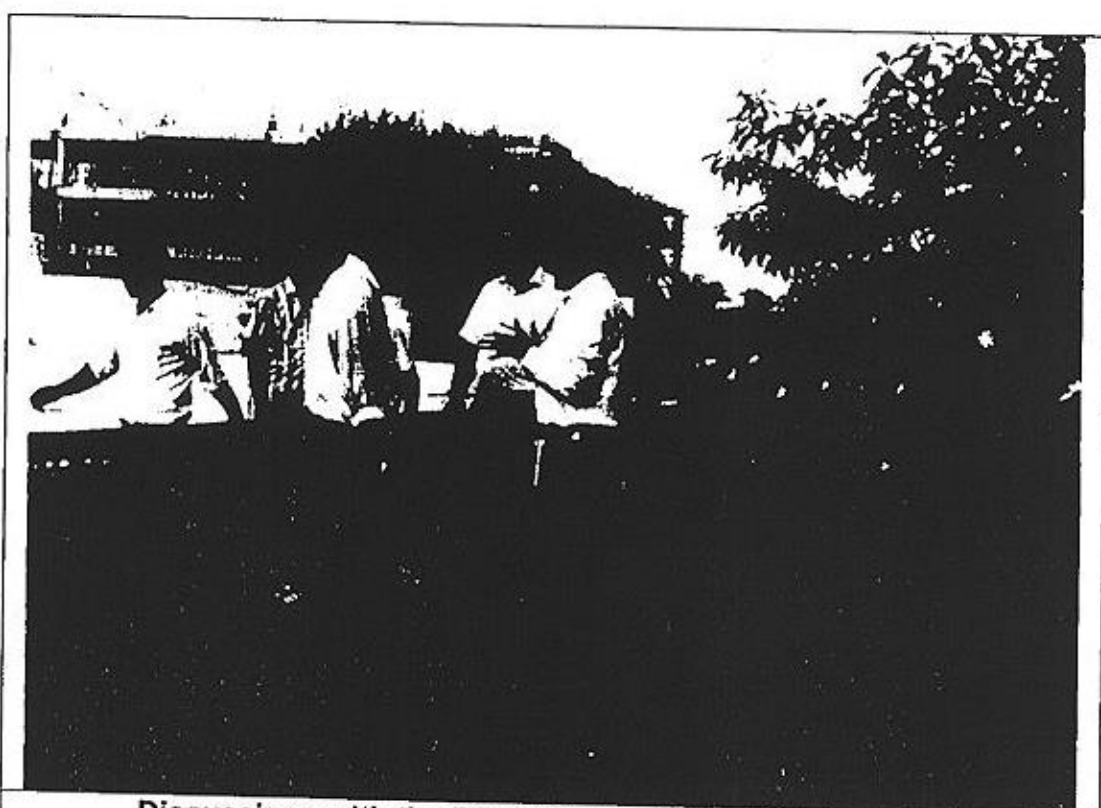


Discussions with the PTU Officials during Detailed Audit

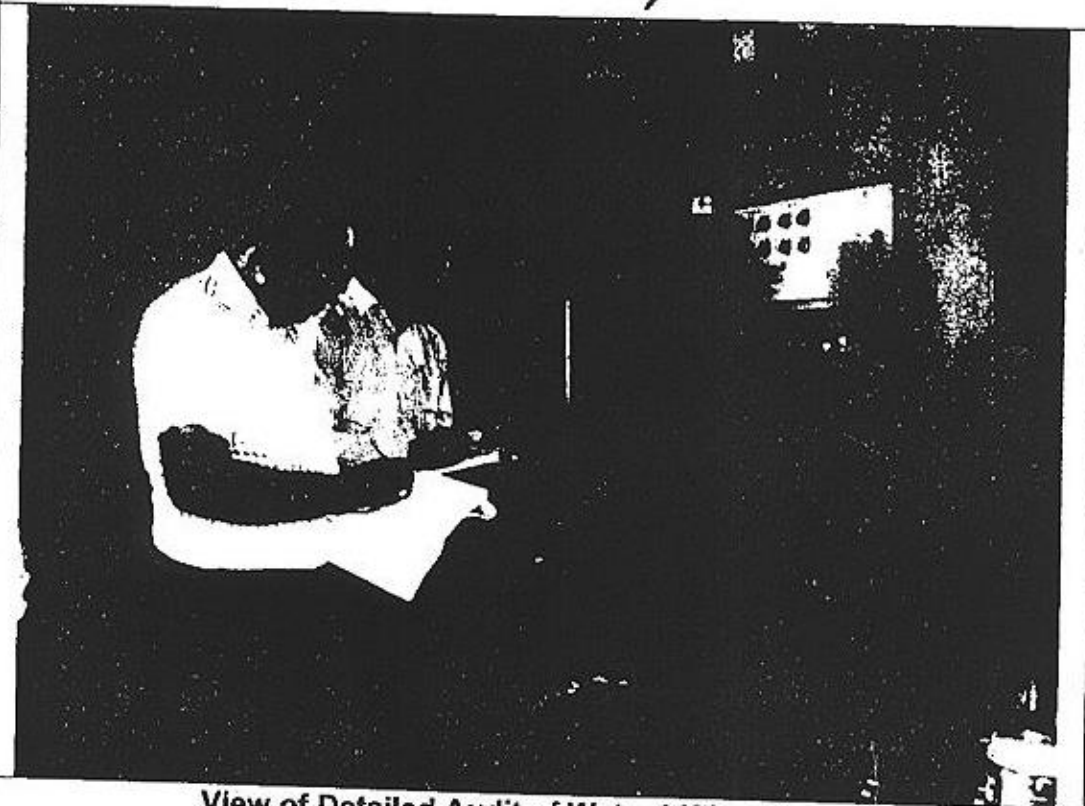

View of Detailed Audit of Water Lifting Pumps

  
H.P. SINGH  
EXECUTIVE ENGINEER  
PUNJAB TECHNICAL UNIVERSITY  
JALANDHAR

 -75-









View of Detailed Audit of Air Conditioner



Detailed Discussions with senior officials of PTU

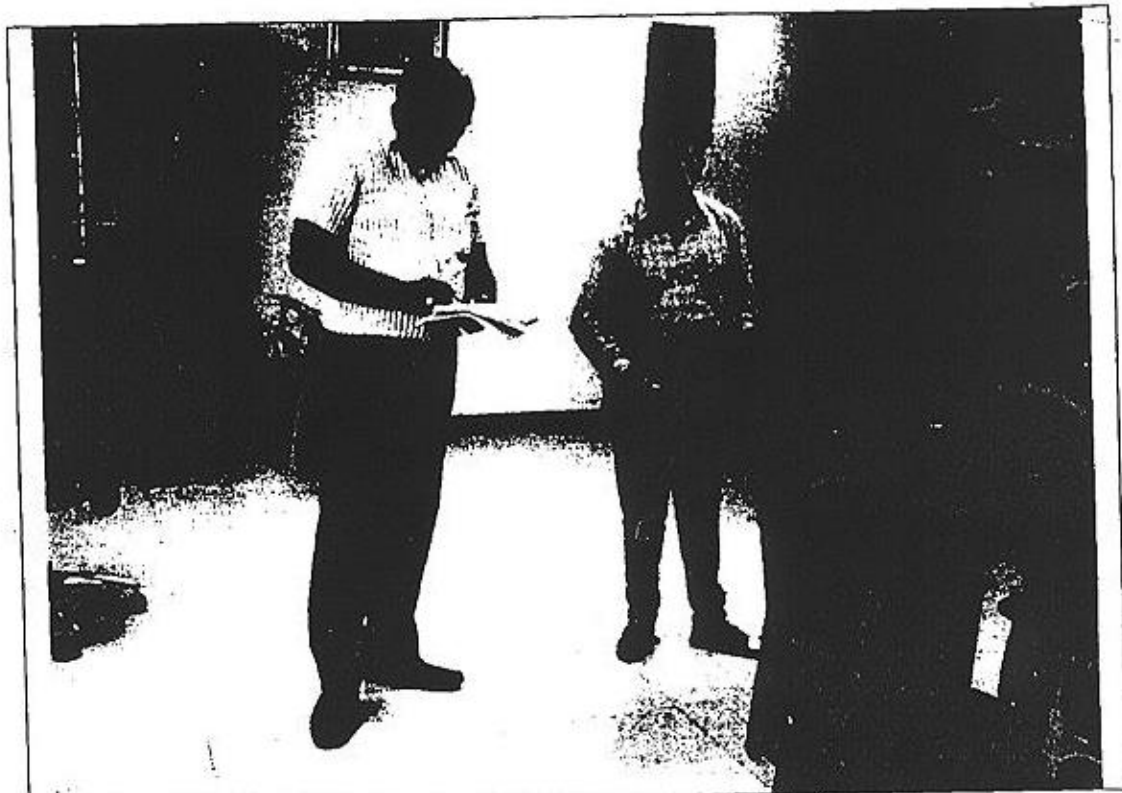

View of detailed audit of indoor lighting

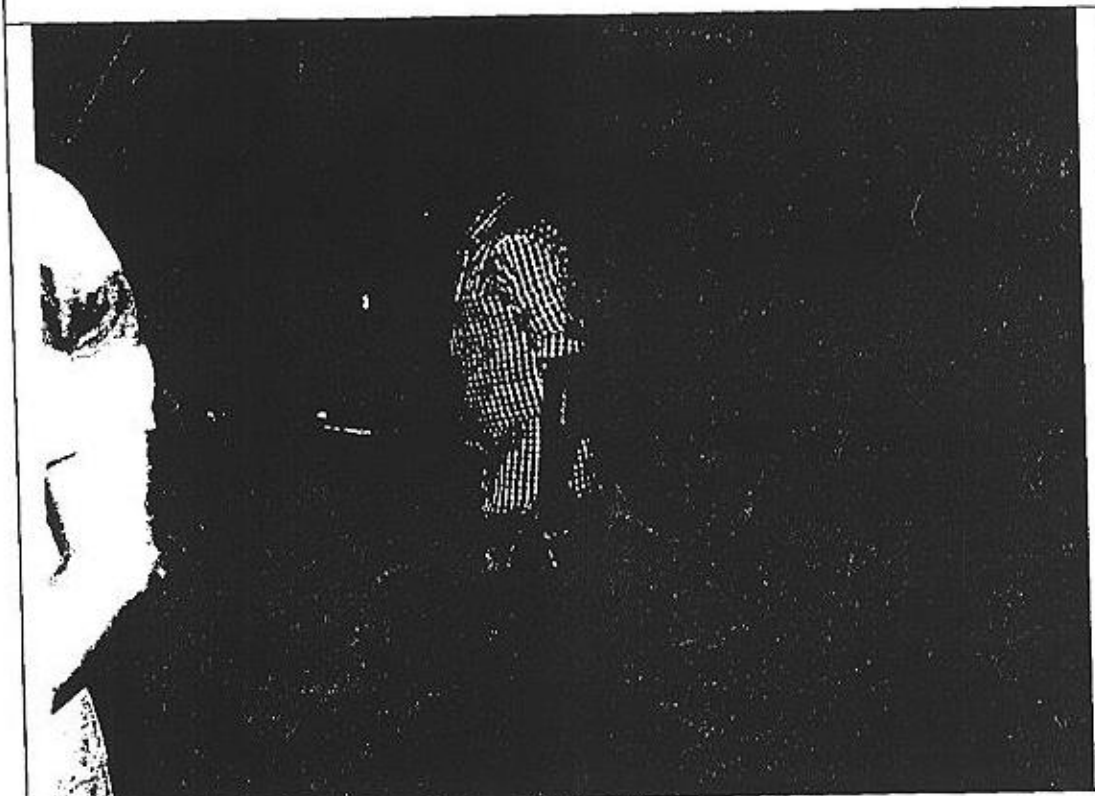

View of detailed audit of outdoor lighting